

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. CONTRACT ID CODE	PAGE OF PAGES 1 OF 6
2. AMENDMENT/MODIFICATION NO. A-002	3. EFFECTIVE DATE 4/3/2018	4. REQUISITION/PURCHASE REQ. NO. PR7169143	5. PROJECT NO. (If applicable)	
6. ISSUED BY GSO Procurement U.S. Embassy in Moscow Bolshoy Deviatinsky Pereulok No. 8 Moscow 121099, Russian Federation		CODE 19RS50	7. ADMINISTERED BY (If other than Item 6) CODE	
8. NAME AND ADDRESS OF CONTRACTOR (No., street, city, county, State, and ZIP Code)			9a. AMENDMENT OF SOLICITATION NO. X 19RS5018Q0018	
			9b. DATED (SEE ITEM 11) 3/19/2018	
			10a. MODIFICATION OF CONTRACT/ORDER NO.	
			10b. DATED (SEE ITEM 13)	
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS				
<p>[X] The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers <input type="checkbox"/> is extended, <input checked="" type="checkbox"/> is not extended</p> <p>Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing Items 8 and 15, and returning 1 copy of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers.</p> <p>FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.</p>				
12. ACCOUNTING AND APPROPRIATION DATA (If required)				
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS, IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.				
<p>A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.</p> <p>B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b)</p> <p>C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:</p> <p>D. OTHER (Specify type of modification and authority)</p>				
<p>E. IMPORTANT: Contractor [X] is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office.</p>				
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)				
<p>This amendment is issued to answer questions that have been asked by potential offerors. See pages 2-6.</p>				
15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME OF CONTRACTING OFFICER Jason Haskins		
15B. NAME OF CONTRACTOR/OFFEROR BY _____ (Signature of person authorized to sign)		15C. DATE SIGNED	16B. UNITED STATES OF AMERICA BY (Signature of Contracting Officer)	16C. DATE SIGNED 4-3-2018

Questions and Answers

Q1: Will the Contractor be provided with any storage space for tools, materials, and equipment required to do the work under the contract? How can the work site be accessed?

A1: Yes, the Contracting Officer Representative will designate a storage space for the Contractor's tools, materials, and equipment on site. The work site can be accessed directly from the street (2 separate doors).

Q2: What is the distance from the floor to the suspended ceiling? What is the distance from the floor to the to the polycarbonate roof?

A2: The distance from the floor to the suspended ceiling is 2.8 meters. The distance from the floor to the polycarbonate roof is approximately 7 meters.

Q3: Please provide the length of the main pipeline, sections on it, and specify the location of the radiators on the original provided drawing.

A3: The revised drawing will be distributed to all offerors that attended the mandatory site visit for the project.

Q4: What is the diameter of the risers?

A4: Connection #1 – DN80; Connection #2 – DN100.

Q5: Please provide a photo of the connection point #2.

A5: See photos on pages 3-6.

Q6: Please provide a photo of the spot where the heating system pipes run into the Am Center's hall.

A6: See photos on pages 3-6.

Q7: Please specify where the heat insulation material must be applied. Are we insulating all parts of the new system?

A7: Heat insulation must be applied to all parts except the radiator branches.

Q8: What's the height of the radiators at the American Center?

A8: The height of the radiators at the American Center is standard, 50 centimeters.

Q9: Is the Contractor required to do anything about the table top that runs along the wall at the American Center?

A9: No.

Q10: What is the distance from the drywall to the main walls?

A10: The distance from the drywall to the main walls is approximately 5-10 centimeters.

Q11: Please specify the mount type for the radiators? How should the radiators be installed?

A11: The contract requires floor mounted radiators. The radiators must be installed on the floor and attached to the wall.

Photo #1



Photo #2




Photo #3



Photo #4



Photo #5

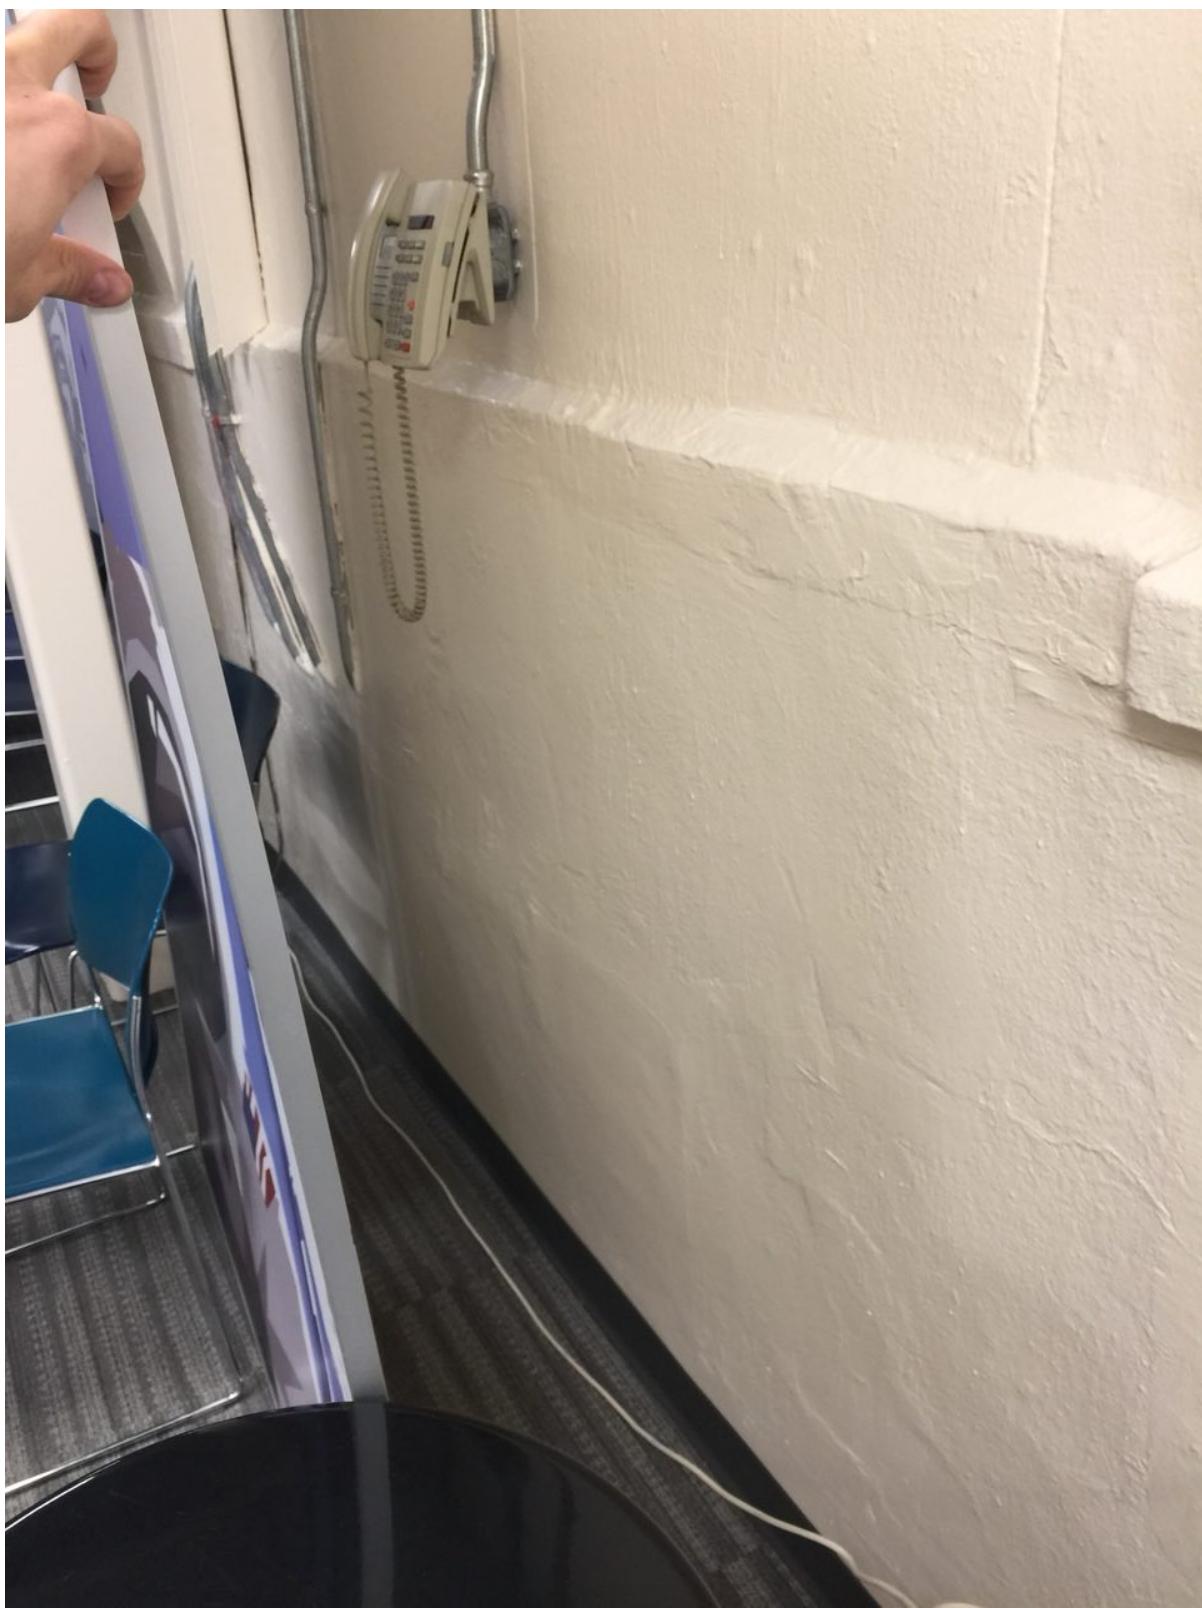

END OF QUESTIONS AND ANSWERS SECTION